
FLOW


air, light, people

ENTRY ID: 6429




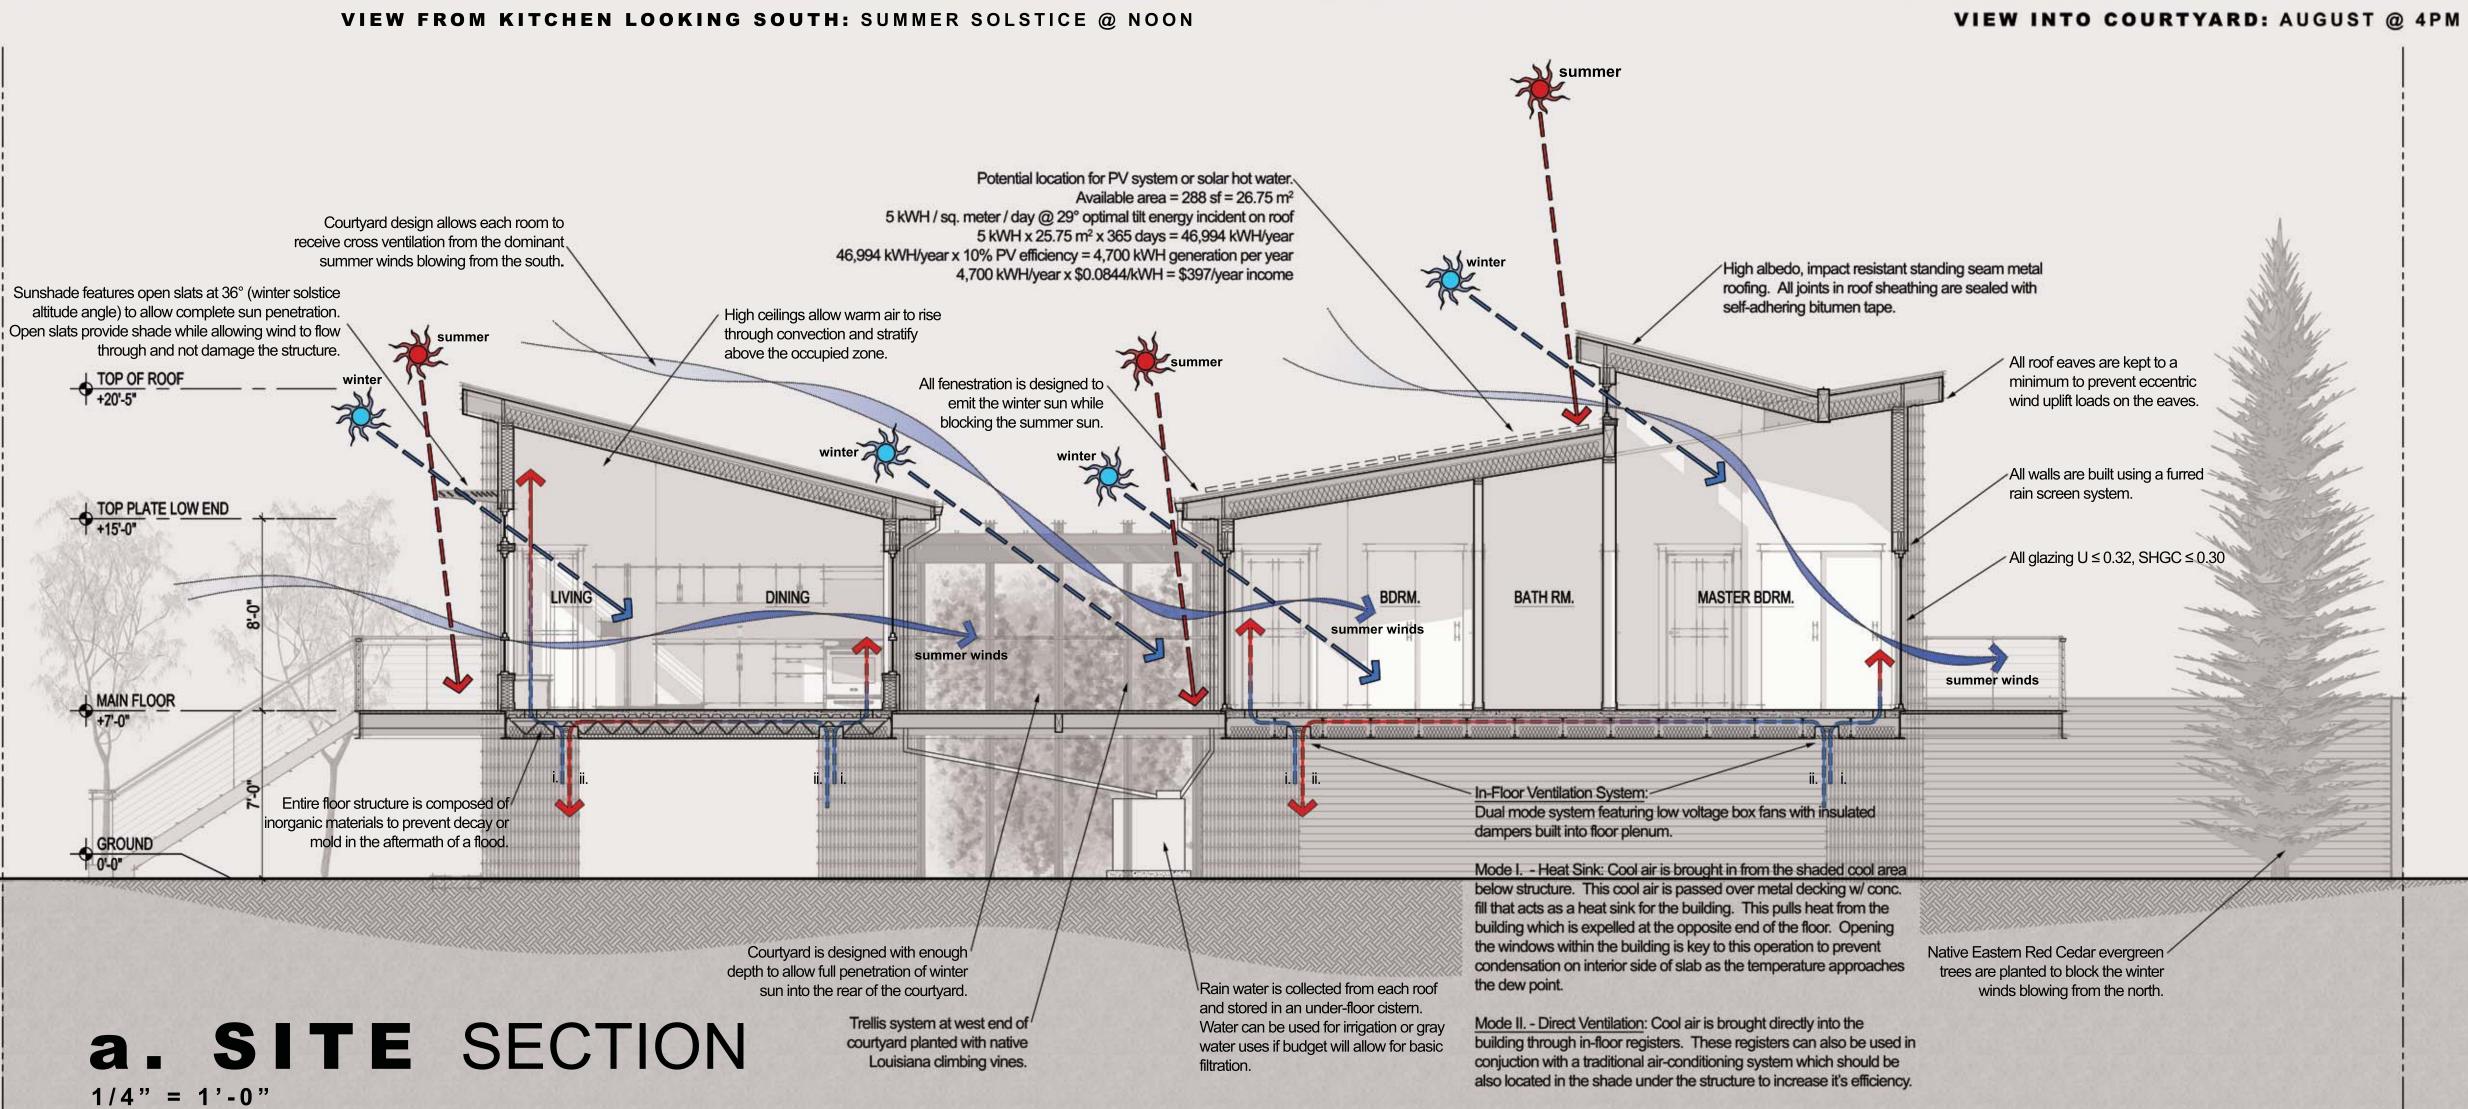

* During winter, insulated dampers close and system doesn't run.

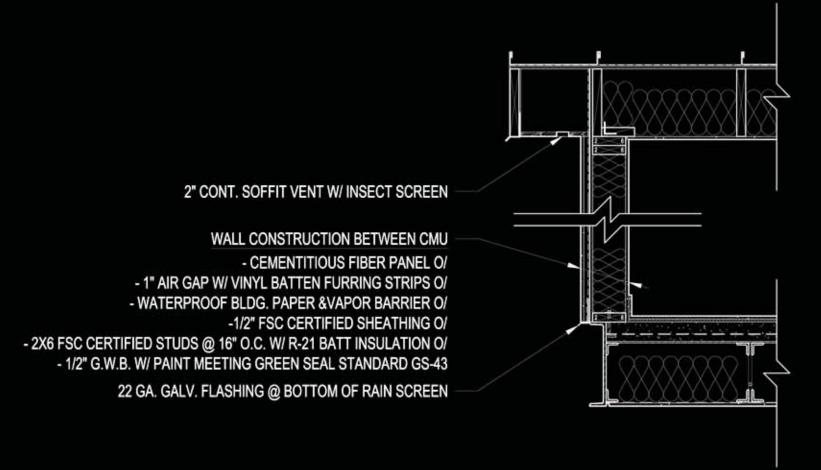

C. WALL SECTION 3/4" = 1'-0"

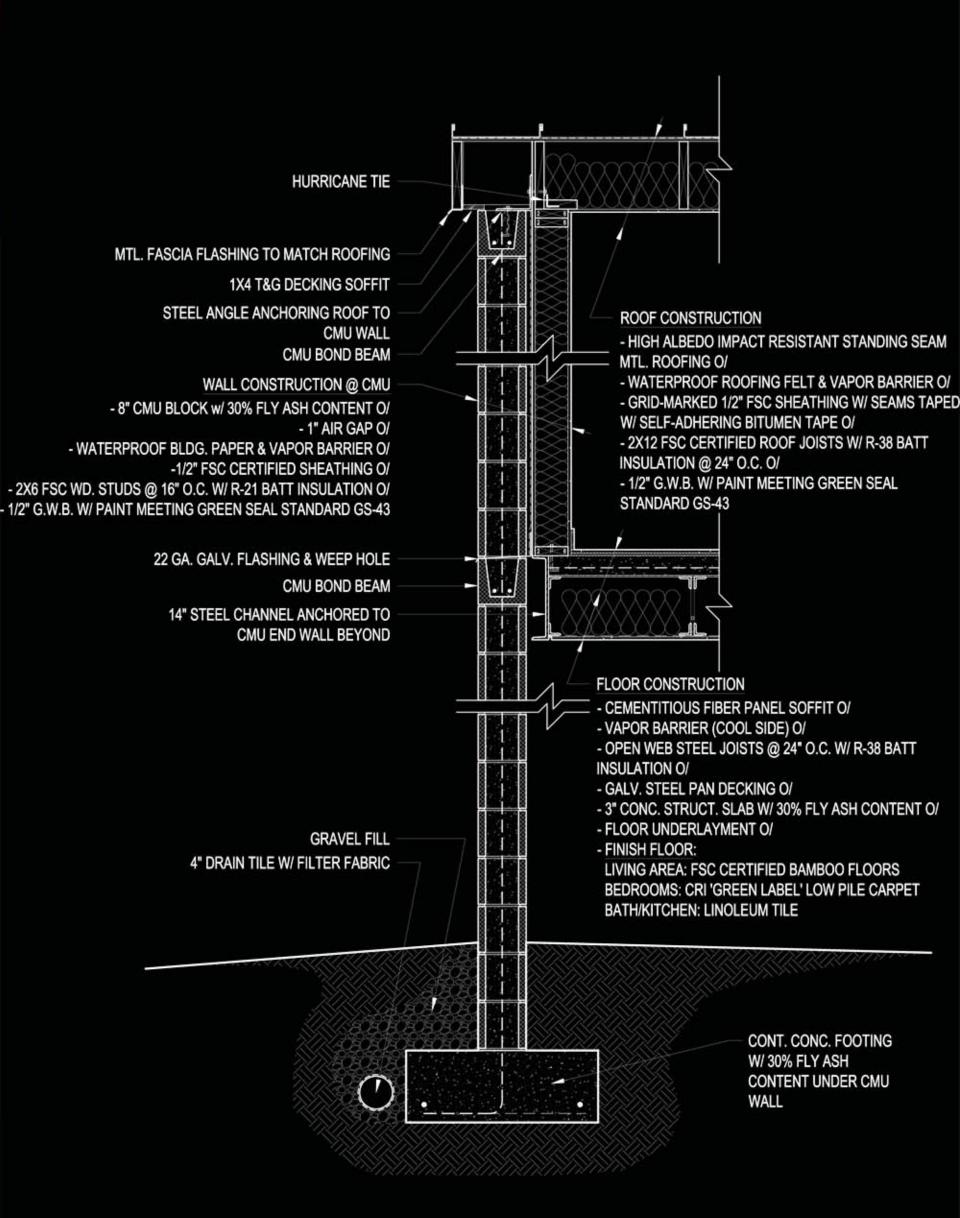

b. WALL SECTION

3/4" = 1'-0"